



# POURED CONCRETE PULL BOXES CONSTRUCTION DETAILS

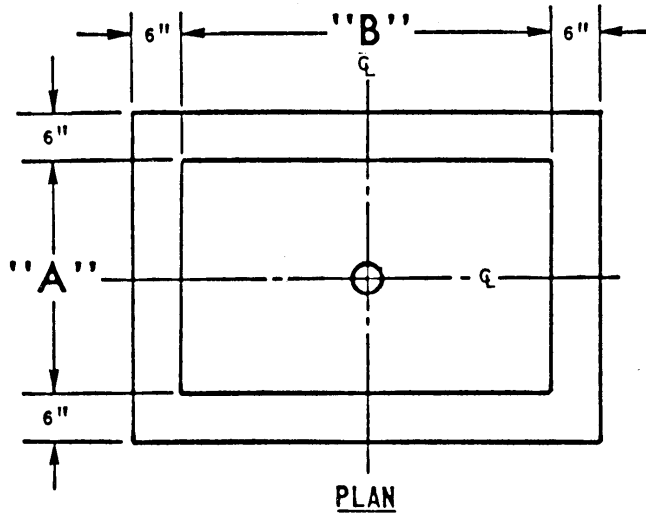

## NOTES:

1. REFER TO DWG. NO. UGS-007 FOR PULL BOX REQUIREMENTS.
2. SEE PAGE NO. 2 THIS DWG. FOR INSTALLATION OF COVER DESIGNATED ON WORKING DRAWING.
3. REINFORCING: TO BE WELDED WIRE FABRIC- 12 GA. -2" SQUARE MESH 3/8 LB. PER SQUARE FOOT.
4. INSERTS: 2 REQUIRED EACH BOX. PER UGS-208.
5. CONCRETE: PER UGS-015.

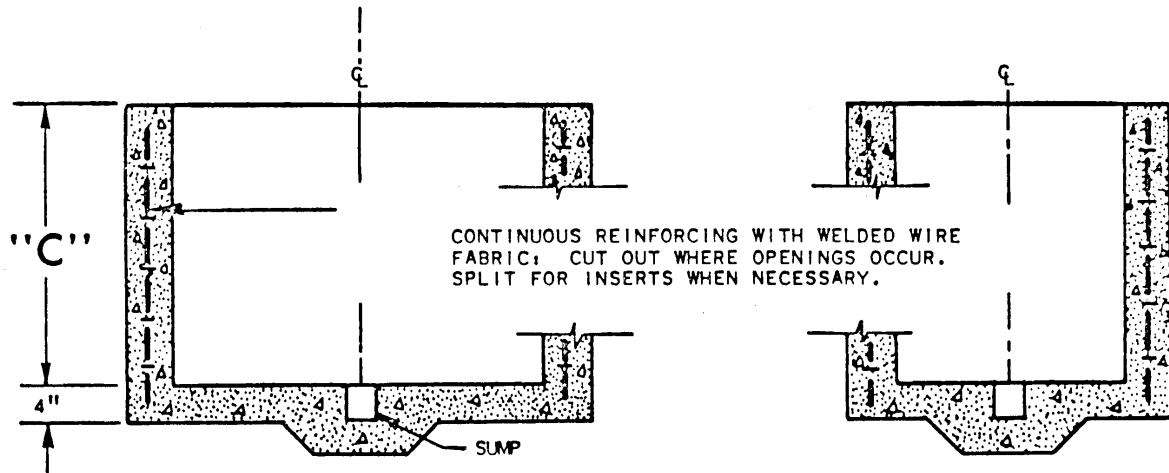

## CENTER LINE SECTIONS

INSIDE DIMENSIONS			CONCRETE	EXCAVATION	REINFORCING	
"A"	"B"	"C"	CUBIC YARDS	CUBIC YARDS	PARKWAY	TRAFFIC
24"	36"	36" MIN.	.81	1.48	NONE	29.3 SQ. FT.
		48" MAX.	1.04	1.92	NONE	38.0 SQ. FT.
30"	48"	36" MIN.	1.05	2.16	NONE	43.5 SQ. FT.
		48" MAX.	1.33	2.81	NONE	57.0 SQ. FT.

# POURED CONCRETE PULL BOXES CONSTRUCTION DETAILS

RIVERSIDE PUBLIC UTILITIES DEPT.- UNDERGROUND STRUCTURES

